


# Ethernet analog input system

## 16 analog inputs, diff., 16-bit

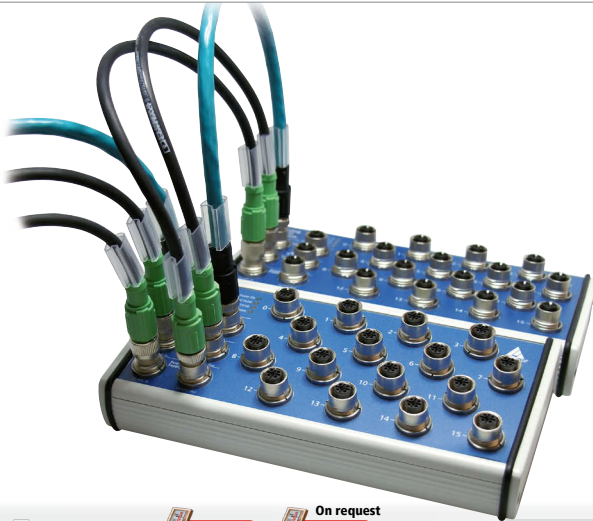

### MSX-E3021

16 analog inputs, differential, 16-bit

Voltage or current inputs

Simultaneous acquisition of 4 channels with 100 kHz per channel

4 GB extended memory

Buffered real-time clock

24 V digital trigger input

Integrated Ethernet switch  
**+85 °C\*** **-25 °C** **+85 °C\*** **-40 °C**  
 \*Operating temperature  
 IP 65  
 ARM<sup>9</sup> Technology  
 Cascadable, can be synchronised in the  $\mu$ s range  
 On request: Compare logic for synchro trigger signal  
 4 GB flash memory, real-time clock



on request



DatabaseConnect  
see page 114



More information on  
[www.addi-data.com](http://www.addi-data.com)

### Features

- 24 V digital trigger input
- ARM<sup>9</sup> 32-bit processor
- 64 MB onboard SDRAM for storing data
- Robust standardized metal housing
- Power Save Mode: Reduced power consumption when no acquisition runs

### Analog inputs

- 16 diff. inputs, 16-bit, 5-pin M12 female connector
- Sampling frequency max. 100 kHz, up to 4 simultaneous channels
- Input ranges:  $\pm 5$  V,  $\pm 10$  V (16-bit), 0-5 V, 0-10 V (15-bit)
- Gain PGA x1, x2, x10, x20, x100, x200, x1000, x2000 software-programmable, signals up to  $\pm 5$ mV (16-bit) are possible
- Current inputs optional

### Safety features

- Status LEDs for fast error diagnostics
- Optical isolation • Input filters
- Overvoltage protection  $\pm 40$  V
- Internal temperature monitoring

### Interfaces

- Fast 24 V trigger input
- Ethernet switch with 2 ports
- Synchronisation/trigger In/Out
- Line in for 24 V supply and cascading


### Communication interfaces

- Web server (configuration and monitoring)
- Command server SOAP for transferring commands
- Data server (TCP/IP or UDP socket) for sending acquisition data
- Event server (TCP/IP socket) for sending system events (Diagnostics such as temperature, short-circuits ...)
- Command server Modbus TCP and Modbus (UDP) for sending commands


### Synchronisation/time stamp

#### Time stamp

Several MSX-E systems can be synchronised with one another in the  $\mu$ s range through a synchro connection. This allows to start a synchronous data acquisition, to generate trigger events and to synchronise the time on several MSX-E systems. Furthermore, the systems have a time stamp that logs the point in time at which the data was acquired by the system.

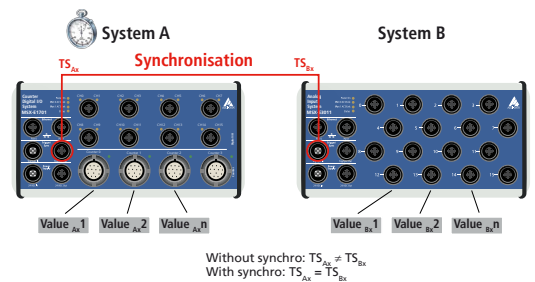

The combination of synchronisation and time stamp (TS) allows the clear allocation of signals that were captured by several systems.

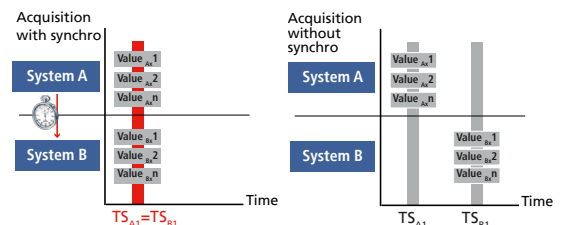


\* Preliminary  
Product information



## Acquisition modes

### Auto-refresh mode


In auto-refresh mode, the measurement values are updated automatically after each acquisition. The acquisition is initialised once and the values of the channels are stored in the memory of the MSX-E Ethernet system. The client (e.g. PC, server, PLC, ...) reads the acquired values asynchronously to the acquisition through socket connection, SOAP or Modbus function. Thereby, the new value is read and the old values are overwritten. In addition to the measurement values, the auto-refresh counter can also be read, which allows to sort the measurement values chronologically. The auto-refresh mode can be combined with a hardware or a synchro trigger and also allows the automatic averaging of values.

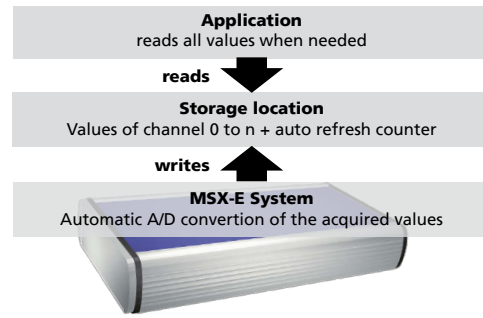

### Sequence mode

In sequence mode, a list of channels is acquired. Thereby, the single measurement rows are stored one after another. The client receives the acquired values asynchronously to the acquisition through a socket connection. In the sequence mode, the measurement values are read in chronological order, this means the oldest values are read first. The acquisition can be effected continuously, with or without delay or in combination with a hardware or synchro trigger.


Example: 8 channels, each with 10  $\mu$ s

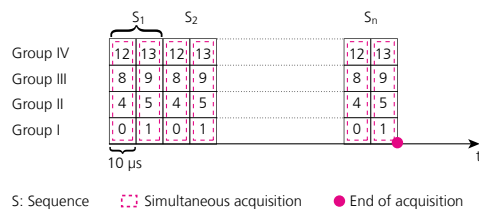

### Horizontal wiring (with 4 gauges/sensors)



### Vertical wiring (with 4 gauges/sensors)

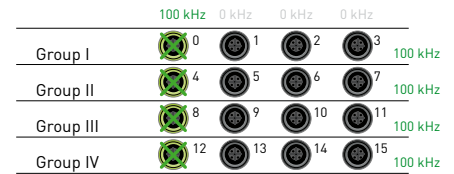


### Acquisition speed

#### Different wiring

for 25 kHz/channel and 100 kHz/groups


### Acquisition triggered through trigger or synchro input

**Example:** A measurement process is to be started through an external trigger impulse. For each trigger, 10 sequences are to be acquired. After the acquisition of the 10 sequences they are to be sent to the client.

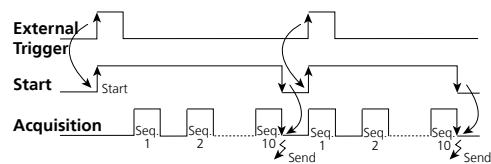

### Reading data from a MSX-E system


MSX-E systems are multi-client capable, this means several clients (e. g. PC, server, PLC, ...) can read the measurement values of one MSX-E system at the same time. For this, each client establishes a socket connection to the data server of the MSX-E system (port 8989). As soon as the measurement values are available on the data server, the MSX-E system transfers them to the clients.

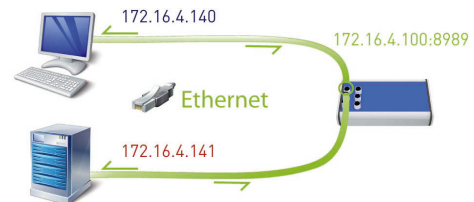

## Onboard programming / stand-alone operation

### Development mode

With the Development mode of the MSX-E systems you can customise your measurement, control and regulation applications to fit your requirements. The programs run directly on the MSX-E systems, which has two advantages: external PCs are relieved and you can process data freely according to your requirements. This helps you to improve the efficiency of your processes and to secure your investments.

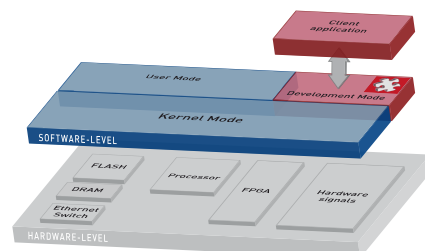

\* Preliminary product information

## ConfigTools

The **ConfigTools** program allows an easy administration of the MSX-E systems. These are automatically detected in the network. **ConfigTools** consists of common and specific functions.



In addition, with **ConfigTools**, the complete configuration of a MSX-E system can be saved and transferred to another system of the same type (clone function).

**ConfigTools** is included in the delivery.

### ConfigTools functions for MSX-E3021:

- Change of IP address
- Display of web interface
- Firmware update
- Save/load system configuration
- Save/load channel configuration
- Monitor for analog inputs

Very easy use through the „ConfigTools“ program; The MSX-E system is automatically detected in the network.

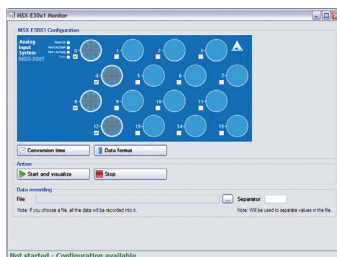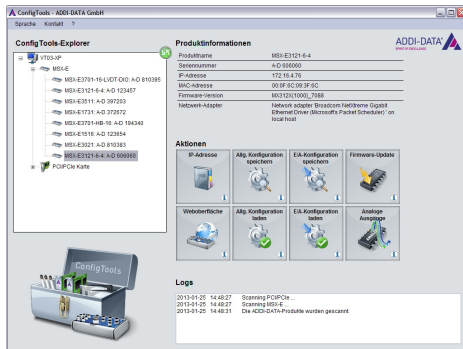


Example of monitor function: Testing the analog inputs.


## Features



## Simplified block diagram

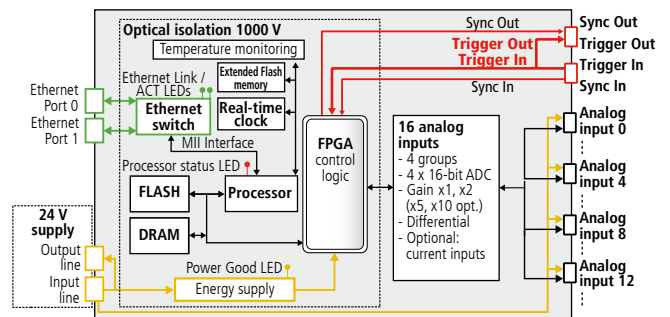


## Cascading

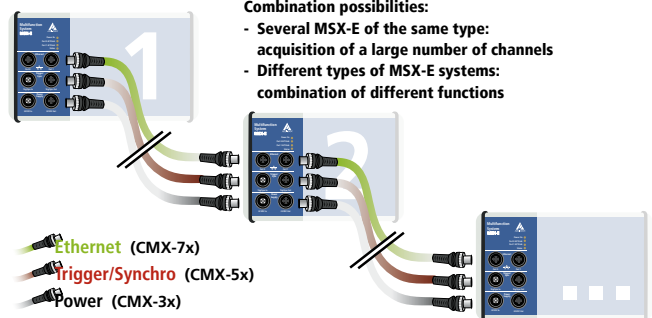

- Combination possibilities:
- Several MSX-E of the same type: acquisition of a large number of channels
  - Different types of MSX-E systems: combination of different functions

## ADDI-DATA connection technology

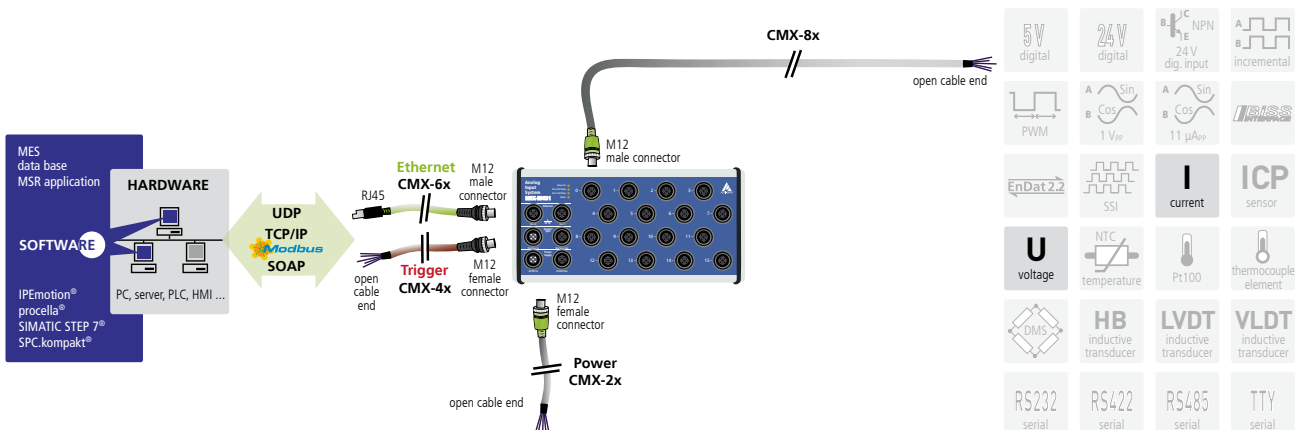

\* Preliminary product information



## Specifications\*

### Analog inputs

Number/type:	16 differential inputs
Architecture:	4 groups of 4 channels each 4-port simultaneous converter with one 4-channel multiplexer per converter
Resolution:	16-bit, SAR ADC
Accuracy:	± 1.221 mV typ. (± 4 LSB) ± 2.442 mV max.
Relative Accuracy (INL):	± 3 LSB max (ADC)
Optical isolation:	1000 V
Input ranges:	± 5 V, ± 10 V (16-bit), 0-5 V, 0-10 V (15-bit) current inputs optional
Sampling frequency:	25 kHz per channel / 100 kHz max.
Gain:	x1, x2, x10, x20, x100, x200, x1000, x2000 software-programmable
Common mode rejection:	80 dB min. DC up to 60 Hz (diff. amplifier)
Input impedance (PGA):	10 <sup>9</sup> Ω // 10nF against GND
Bandwidth (-3dB):	160 kHz limited through TP filters 16 Hz version with differential filter
Trigger:	digital input, synchro, software-programmable
Offset error:	± 1 LSB (± 305 µV)
Gain error:	± 2.5 LSB
Temperature drift :	2.3 x V <sub>in</sub> + 22.5 (µV/°C) typ. V <sub>in</sub> : input voltage in Volts (-10 V ≤ V <sub>in</sub> ≤ +10 V) In the temperature range from -40°C to +85°C: 4.5 ppm/°C FSR

### Data storage

RAM:	64 MB
FLASH:	4 MB for system data
Extended FLASH memory:	4 GB (3.7 GB for measured data)
Buffered real-time clock:	approx. 4 weeks at 20 °C

### Voltage supply, Ethernet, Trigger, Synchro

The specifications for the voltage supply, Ethernet, Trigger, Synchronisation and Electromagnetic Compatibility apply to all MSX-E systems. See page 31.

### System features

Interface:	Ethernet acc. to specification IEEE802.3
Dimensions:	215 x 110 x 50 mm
Weight:	850 g
Degree of protection:	IP 65
Current consumption at 24 V:	180 mA
Operating temperature:	-25 °C to +85 °C -40 °C to +85 °C on request

### Connectors for sensors

For analog inputs: 8 x 5-pin M12 female connector

## Ordering information

### MSX-E3021

Ethernet analog input system, 16 analog inputs, diff., 16-bit. Incl. technical description, software drivers and ConfigTools.

### Connection cables

#### Voltage supply

**CMX-2x:** Shielded cable, M12 5-pin female connector/open end, IP 65

**CMX-3x:** For cascading, shielded cable, M12 5-pin female connector/male connector IP 65

#### Trigger/Synchro

**CMX-4x:** Shielded cable, M12 5-pin female connector/open end, IP 65

**CMX-5x:** For cascading, shielded cable, M12 5-pin female connector/male connector IP 65

#### Ethernet

**CMX-6x:** CAT5E cable, M12 D-coded male connector/RJ45 connector

**CMX-7x:** For cascading, CAT5E cable, 2 x M12 D-coded male connector

#### Connection to peripherals

**CMX-8x:** Shielded cable, M12 5-pin male connector/open end, IP 65

### Options

**PC-Diff:** Current input 0(4)-20 mA for 1 input, diff.  
(please indicate the number of channels)

**S7 Modbus TCP Client Library for S7:** Easy use of the Ethernet systems MSX-E with PLCs

**MSX-E 5V-Trigger:** Level change of the trigger inputs and outputs to 5 V

**MX-Clip, MX-Rail** (please specify when ordering!),

**MX-Screw, PCMX-1x**